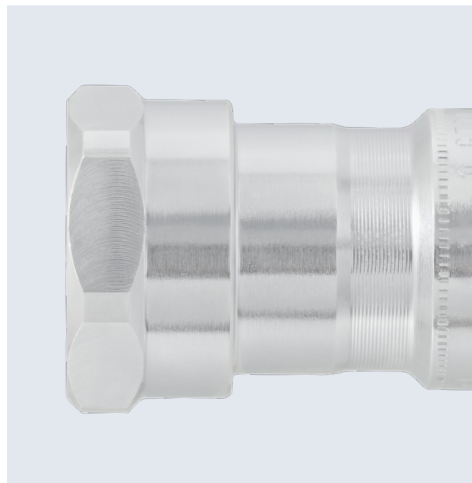
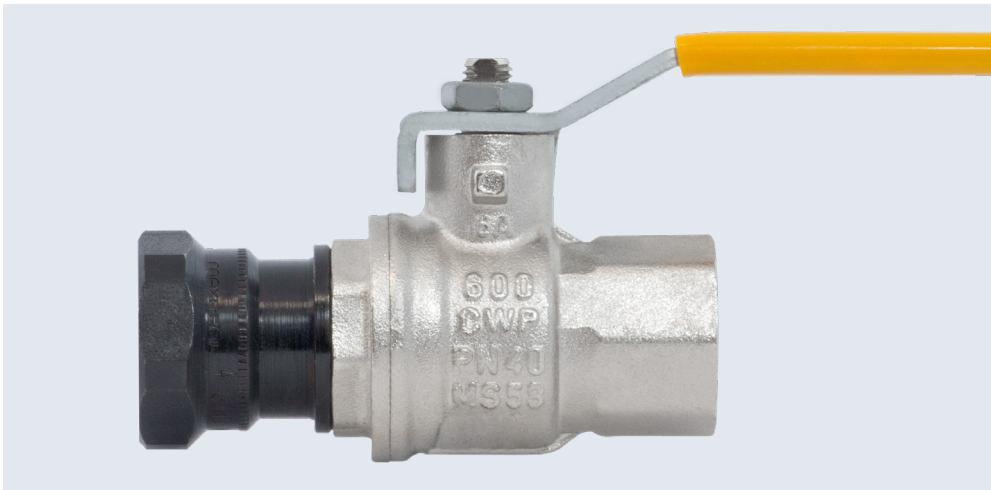


SENTRY GT / GT..KD40

THERMAL CUT-OFF DEVICES AND BALL VALVES

MAXITROL®

www.maxitrol.com

CONTENT


- 1 DESCRIPTION
CERTIFICATION
- 2 TECHNICAL DATA
INSTALLATION KITS
- 3 FLOW RATE CHARTS
EXAMPLES
FLOW RESISTANCE FACTOR
- 4 CONNECTIONS AND DIMENSIONS
- 5 OPTIONS

DESCRIPTION

SENTRY GT Thermal Cut-off Devices (TCO) help prevent gas from flowing to downstream components that may not be resistant to high temperatures. These thermal cut-off devices automatically shut off the gas flow at temperatures between 197.6°F and 212 °F. The SENTRY GT..KD40 ball valve may also be used as a main gas manual shut-off valve.

SENTRY GT THERMAL CUT-OFF DEVICE

The release mechanism (temperature sensor) retains the closing unit, which is mounted under spring pressure. At the release temperature, the release mechanism unblocks the closing unit, and the closing unit moves into the seat resulting in a gas-tight seal. The SENTRY GT remains closed after it cools (see figure 1).

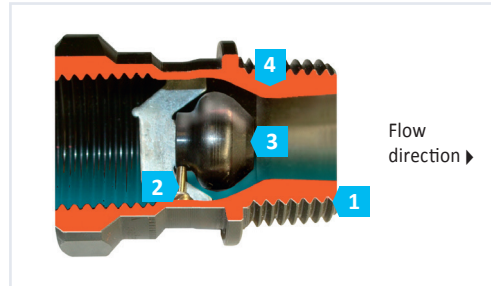


◀ Figure 1
Cross-section of a SENTRY GT (GT15DIA) thermally activated cut-off device

- 1 Housing
- 2 Release Mechanism
- 3 Closing Unit
- 4 Seat

BALL VALVE SENTRY GT..KD

To close the ball valve, the lever must be turned clockwise 90°. To open the ball valve, turn the lever counterclockwise 90°. The ball valve is open when the lever is in the flow direction of the pipe (see figure 2). The ball valve should be opened slowly to avoid pressure surge.

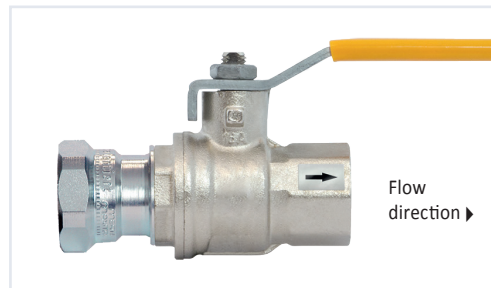

◀ Figure 2
SENTRY GT..KD40 ball valve

CERTIFICATIONS

SENTRY GT TCOs are certified in compliance with:

- Pressure Equipment Directive (2014/68/EU)
- DIN 3586

and meet the requirements of:

- German FeuVO
- IGEM/G/5 Edition 3, 2022 for Gas in multi-occupancy buildings
- DVGW-Code of Practice G600 (TRGI-2018)
- DVFG TRF 2021

German fire code draft recommendation 02/95, Edition 09/97, the legal basis for Germany's regional buildings and fire codes, mandates the use of a thermally activated cut-off device.


Gas pipes supplying gas appliances must be equipped with a device:

1. That automatically shuts off the gas flow when subjected to temperatures > 212 °F.
2. That allows no more than 7.925gal/h measured in air to pass through the device for a period of at least 30 minutes at temperatures up to 1201 °F in compliance with DIN 3586 (Maxitrol tested up to 1697 °F) when tripped.


(Figure 3, page 2 shows that during a fire the temperature reaches 1292 °F within 15 minutes.)

Certifications (Range of use)	SENTRY GT	SENTRY GT..KD
Pressure Equipment Directive	2014/68/EU	2014/68/EU
DVGW	3/8" - 2" NPT: DIN 3586 1 1/4" - 2" NPT: DIN 3586 (EN 1775, DVFG TRF 2021, DVGW TRGI 2018)	DIN EN 331; DIN 3586 (EN 1775, DIN 3537-1, DVFG TRF 2021, DVGW TRGI 2018)

TECHNICAL DATA

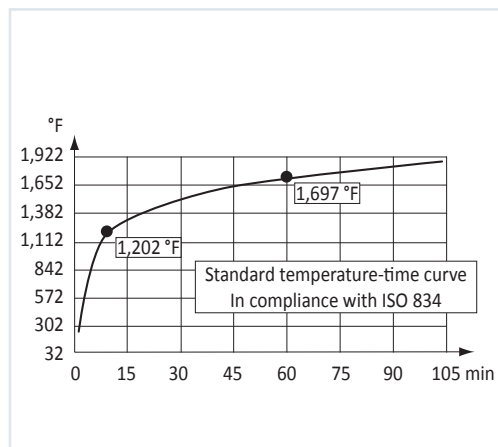

▲ Figure 3: Temperature rise in a test room fire simulation

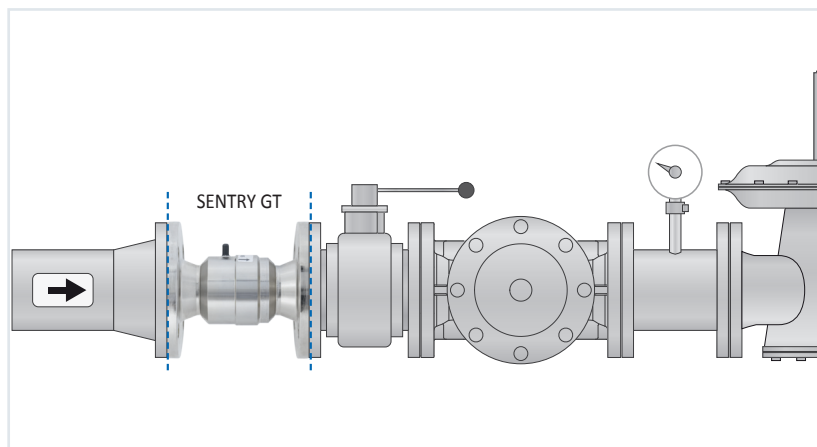

▲ Figure 4: Example of a SENTRY GT installed upstream of a burner

Technical data	SENTRY GT	SENTRY GT..KD
Threaded connection	DIN EN 10226-1 / ISO 7-1	DIN EN 10226-1 / ISO 7-1
Flanged connection	DIN EN 1092-1:2018-12 (PN 16) / ISO 7005-1	-
Gas types	DIN EN 437; DVGW G 262	DIN EN 437
Release temperature	212 °F – 14,400 °F	212 °F – 14,400 °F
Nominal pressure	MOP 5 (PN 5, DIN 3586)	MOP 5 (PN 5, DIN 3586)
Allowable leakage	< 7.9 gal/h air at 1202 °F	< 7.9 gal/h air at 1202 °F
Ambient temperature	-4 °F to 176 °F	-4 °F to 140 °F
Thermal rating	30 min 1202 °F in compliance with DIN 3586; (Maxitrol tested up to 1697 °F)	30 min 1202 °F in compliance with DIN 3586
Material	Steel	Brass, Steel

INSTALLATION KITS


Installation Kit for SENTRY GT

In compliance with applicable industry standards, an installation kit is required for the installation of flanged versions of thermal cut-off devices. This kit consists of high temperature resistant flange gaskets, hexagonal screws and hexagonal nuts. All flanged units must use high temperature resistant gaskets in compliance with Standard DIN EN 1092-1:2018-12 (PN 16) / ISO 7005-1.


Only use high temperature resistant flange gaskets in compliance with DIN 30653 (HTR) up to 72 psi (Marked by: 3 red marks staggered 248°). For a list of high temperature resistant gasket kits see Maxitrol literature GT-DS-DE.EN....

SENTRY GT	Installation Kit	Nominal Pipe Size
GT32FF	SENTRY GT 32 M2(3)	1¼" NPS
GT40FF	SENTRY GT 40 M2(3)	1½" NPS
GT50FF	SENTRY GT 50 M2(3)	2" NPS
GT65FF	SENTRY GT 65 M2(3)	2½" NPS
GT80FF	SENTRY GT 80 M2(3)	3" NPS
GT100FF	SENTRY GT 100 M2(3)	4" NPS
GT125FF	SENTRY GT 125 M2(3)	5" NPS
GT150FF	SENTRY GT 150 M2(3)	6" NPS

FLOW RATE CHARTS (Natural Gas d = 0.6; pi = 0.01 w.c.)

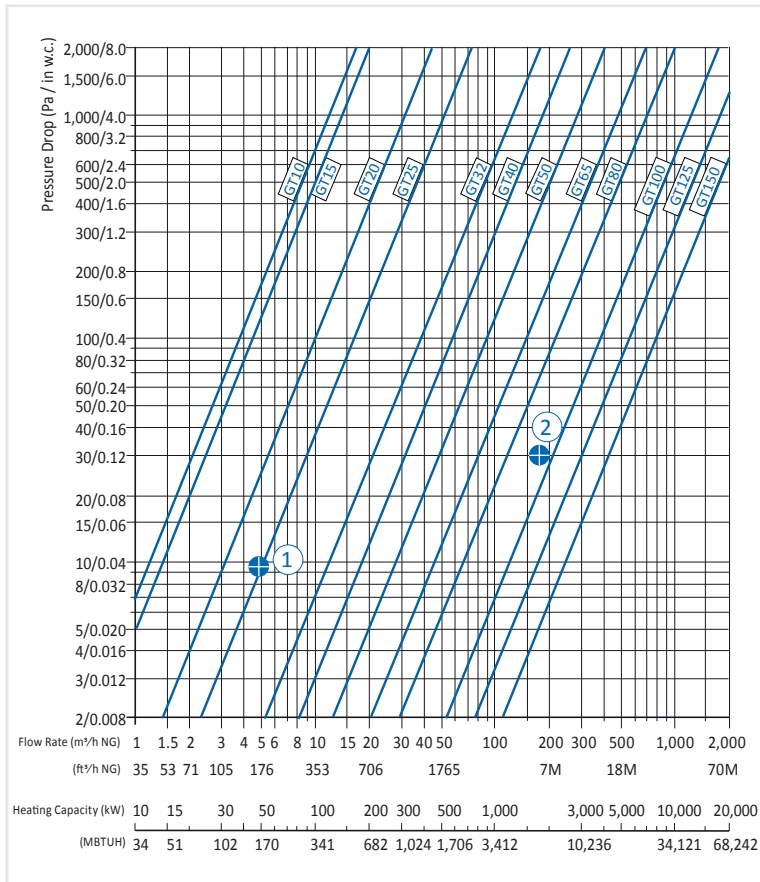

▲ Figure 5: SENTRY GT

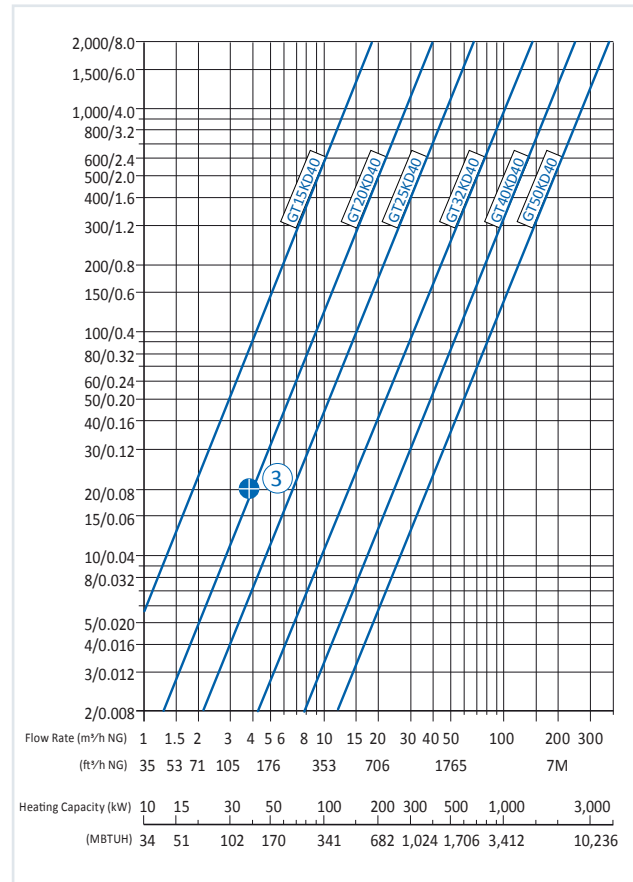

▲ Figure 6: SENTRY GT..KD40

EXAMPLES (see figure 5 and 6)







- ① For a 170 MBTUH boiler with a flow rate of ca. 175 ft³/h natural gas, the pressure drop for a GT25 would be 0.038 w.c.
- ② The pressure drop of a GT for a 5100 MBTUH boiler may not exceed 0.12 w.c. Choose the next characteristic line below plot point ② (GT100).
- ③ The pressure drop of a GT20KD40 with a flow rate of 140 ft³/h natural gas would be 0.08 w.c.

FLOW RESISTANCE FACTOR

Flow resistance factor ζ (zeta) for SENTRY GT

¾" NPT	½" NPT	¾" NPT	1" NPT	1¼" NPT	1½" NPT	2" NPT	2½" NPT	3" NPT	4" NPT	5" NPT	6" NPT
1.5	4.5	3.0				1.5				1.8	

CONNECTIONS AND DIMENSIONS

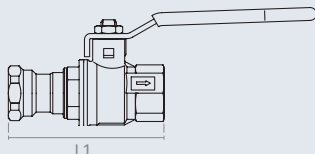Illustration	Type (Order Code)	Connection (others on request)		Surface	Dimensions [inch]			Weight [lb]	Cert. No.
		Inlet	Outlet		L1	L2	SW Wrench size		
	GT20BLC0	Internal thread 3/4" NPT	External thread 3/4" NPT	blue galvanized	1.77	1.299	1.417	0.3	CE-0085BN0394
	GT10DIA0	Internal thread 3/8 NPT	External thread 3/8 NPT	blue galvanized	1.57	28.4	0.866	0.11	CE-0085BN0394
	GT15DIA0	1/2 NPT	1/2 NPT		1.57	24.7	1.06	0.154	
	GT20DIA0	3/4 NPT	3/4 NPT		1.98	34.0	1.259	0.220	
	GT25DIA2	1 NPT	1 NPT	black galvanized	2.118	34.6	1.614	0.4629	
	GT15DII0	Internal thread 1/2 NPT	Internal thread 1/2 NPT	blue galvanized	1.79	-	1.06	0.220	CE-0085BN0394
	GT20DII0	3/4 NPT	3/4 NPT		2.145	-	1.259	0.3307	
	GT25DII2	1 NPT	1 NPT	black galvanized	2.42	-	1.614	0.661	
	GT32IA4	Internal thread 1 1/4 NPT	External thread 1 1/4 NPT		3.93	0.842	2.165	1.675	CE-0085BN0395
	GT40IA4	1 1/2 NPT	1 1/2 NPT		4.409	0.842	2.56	3.218	
	GT50IA4	2 NPT	2 NPT		5.315	25.7	3.149	5.55	
	GT32II4		Internal thread 1 1/4 NPT	nickel plated	3.93	-	2.165	2.5	
	GT40II4	1 1/2 NPT	1 1/2 NPT		4.409	-	2.56	3.88	
	GT50II4	2 NPT	2 NPT		5.315	-	3.149	5.732	
DN 150 protection cage 	GT32FF4	Flange connection 1 1/4" NPT	Flange connection 1 1/4" NPT	nickel plated	5.433	-	-	5.511	
	GT40FF4	1 1/2" NPT	1 1/2" NPS		6.102	-	-	8.157	
	GT50FF4	2" NPT	2" NPT		6.889	-	-	13.448	
	GT65FF4	2 1/2" NPT	2 1/2" NPT		7.756	-	-	17.196	
	GT80FF4	3" NPT	3" NPT		9.01	-	-	24.25	
	GT100FF4*	4" NPT	4" NPT		10.511	-	-	33.73	
	GT125FF*	5" NPT	5" NPT		8.818	-	-	57.32	
	GT150FF*	6" NPT	6" NPT		10.551	-	-	70.574	
	* Dispatch only by forwarder								
	GT15KD40	RP 1/2	RP 1/2	nickel plated / blue galvanized	75.5	-	27	0.25	CE-0085AQ1219 CE-0085BN0394 / CE-0085BN0395
	GT20KD40	RP 3/4	RP 3/4		90.0	-	32	0.40	
	GT25KD40	RP 1	RP 1	nickel plated / black galvanized	121.0	-	41	0.75	
	GT32KD40	RP 1 1/4	RP 1 1/4	nickel plated	185.0	-	55	1.62	
	GT40KD40	RP 1 1/2	RP 1 1/2		207.0	-	65	2.54	
	GT50KD40	RP 2	RP 2		246.0	-	80	3.86	

OPTIONS

To order a biogas resistant version of the 1 ¼" NPS through 6" NPT, replace the "4" with a "9" at the end of the order code (e.g. GT32FF9). To order a biogas resistant version of the 5" NPT and 6" NPT add a "9" to the end of the order code (e.g. GT150FF9).

In addition to the standard versions listed in the table above, Custom inlet and outlet connections are available.



◀ Figure 7
SENTRY GT Model Range

© 2022 Maxitrol GmbH & Co. KG, All Rights Reserved.

MORE PRODUCTS

SENTRY GS EXCESS FLOW VALVE

Excess flow valves (EFVs) close, shutting off the gas flow, when a predefined flow rate is reached. Maxitrol's factory adjustment (100%) provides a precise and reliable closing flow rate. In the nominal flow range, the EFV remains in a stable, open position.



◀ Figure 9
SENTRY GS combined with a thermally activated shut-off device; PLUG1 gas outlet (from left to right)



© 2022 Maxitrol GmbH & Co. KG, All Rights Reserved.

Maxitrol Company
23555 Telegraph Road
Southfield, MI 48033
USA

T: (+1) 248 356-1400
infoNA@maxitrol.com

Maxitrol GmbH & Co. KG
Valleys Innovation Centre
Navigation Park
Abercynon CF45 4SN
United Kingdom

T: (+44) 1443 742-755
M: (+44) 7866 492-261
infoEU@maxitrol.com

Maxitrol GmbH & Co. KG
Warnstedter Str. 3
06502 Thale
Germany

T: (+49) 3947 400-0
infoEU@maxitrol.com

Maxitrol GmbH & Co. KG
Industriestr. 1
48308 Senden
Germany

T: (+49) 2597 9632-0
senden@maxitrol.com